

Doc 1316. Section 4.14 Plumbing Guidelines. Piping the Mascot ST for use with Air Handling Systems.

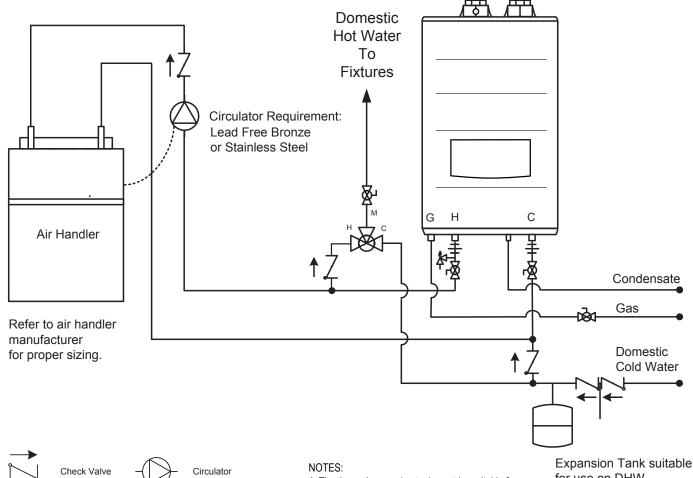



- 1. The thermal expansion tank must be suitable for potable water and between the backflow preventer and the cold water inlet.
- 2. Drawings are for piping reference only. The installer is responsible for all equipment and detailing required by local codes.
- 3. In Massachusetts, a vacuum relief valve must be installed per 248 CMR.
- 4. In Massachusetts, state plumbing code requires a distance no greater than 50 feet from the water heater to the fail coiler in the air handler.
- 5. In Massachusetts, state plumbing code requires an electronically timed circulator pump to activate every six hours for 60 seconds. Circulator pump must be lead free bronze or stainless steel.
- 6. The air handler must be suitable for use with Domestic Hot Water.

for use on DHW.

H2384600-

