

For use with **LT SERIES** tankless water heaters



Date:

Project #:

Engineer:

Prepared By:

Bid Date:



Submittal Data




Project Name:

Location:

Contractor:

Standard Equipment

- Assemble to the exhaust collar of each heater in a common PVC or CPVC vent system, to prevent combustion products from one heater from back flowing into an adjacent heater that shares a common vent system.

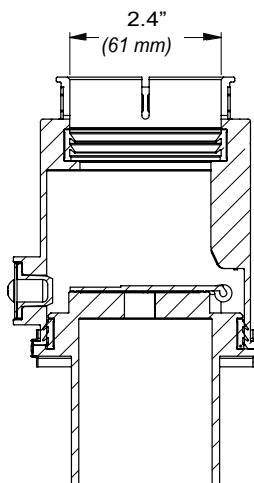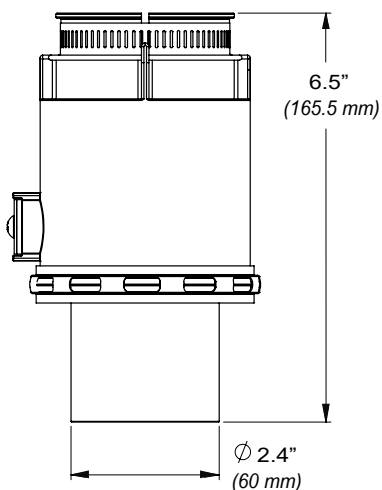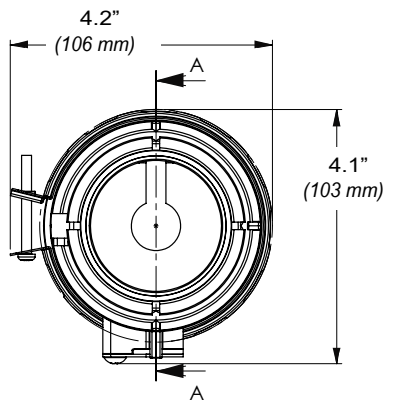

Section View A-A

