



# SINGLE BOILER, PRIMARY/SECONDARY, RADIANT PIPE

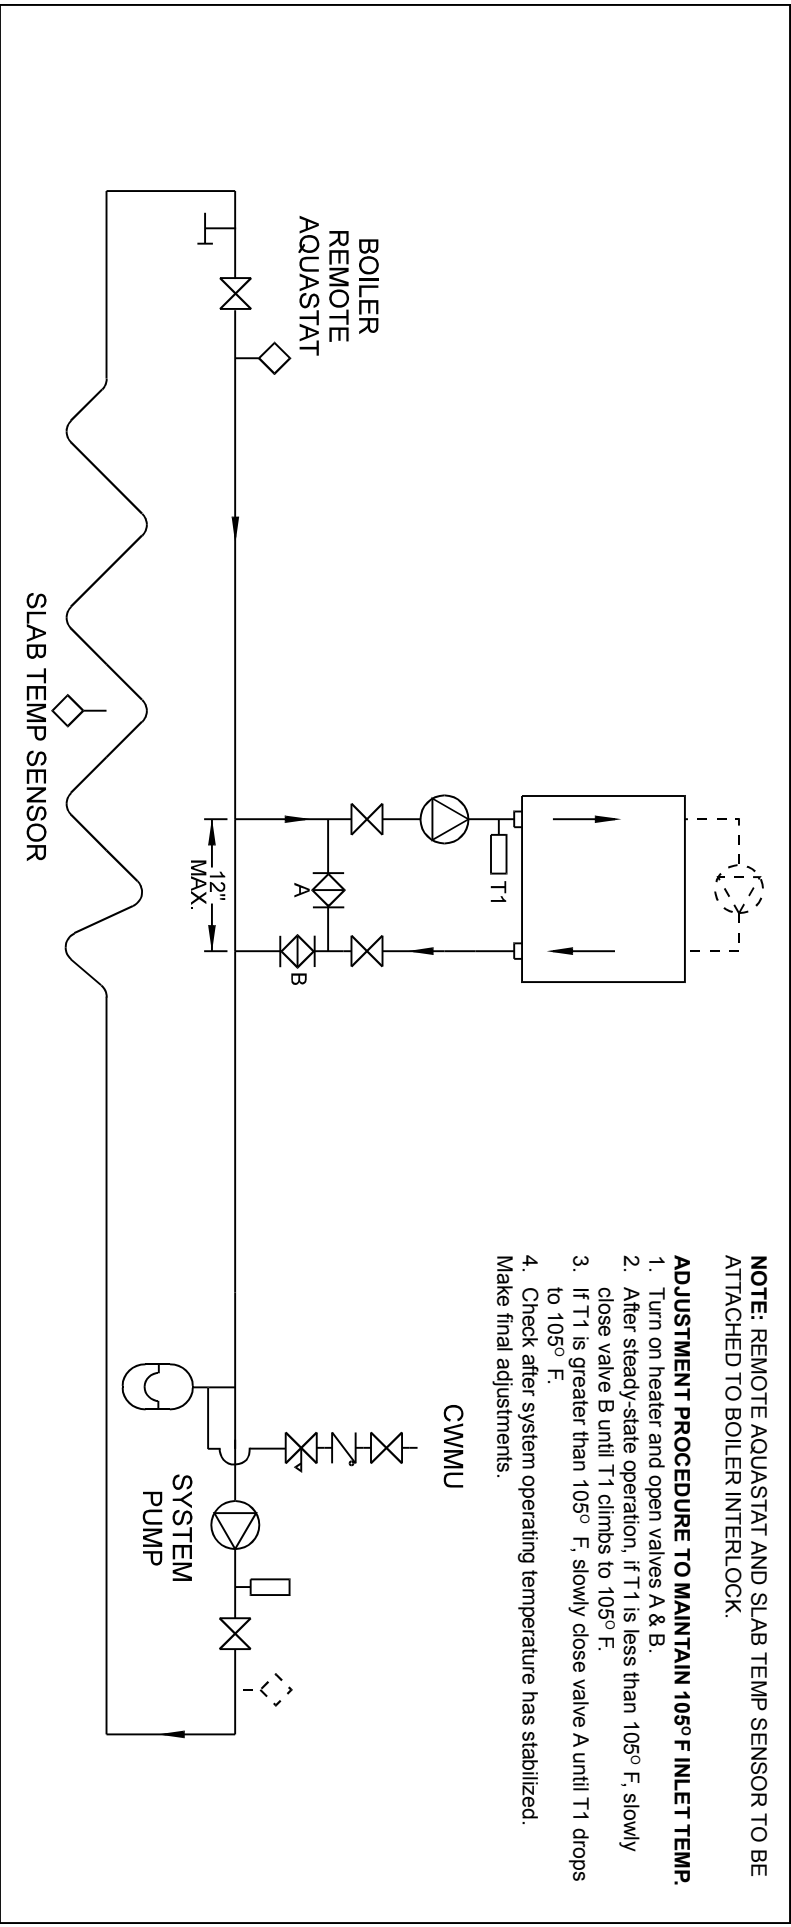

|      |       |                 |             |                         |             |                    |             |             |                                    |                   |
|------|-------|-----------------|-------------|-------------------------|-------------|--------------------|-------------|-------------|------------------------------------|-------------------|
| PUMP | VALVE | BALANCING VALVE | CHECK VALVE | PRESSURE REDUCING VALVE | 3-WAY VALVE | TEMPERATURE SENSOR | THERMOMETER | PURGE VALVE | EXP. TANK & AIR ELIMINATION DEVICE | UNIT MOUNTED PUMP |
|      |       |                 |             |                         |             |                    |             |             |                                    |                   |

# MULTIPLE BOILERS, PRIMARY/SECONDARY, RADIANT PIPE

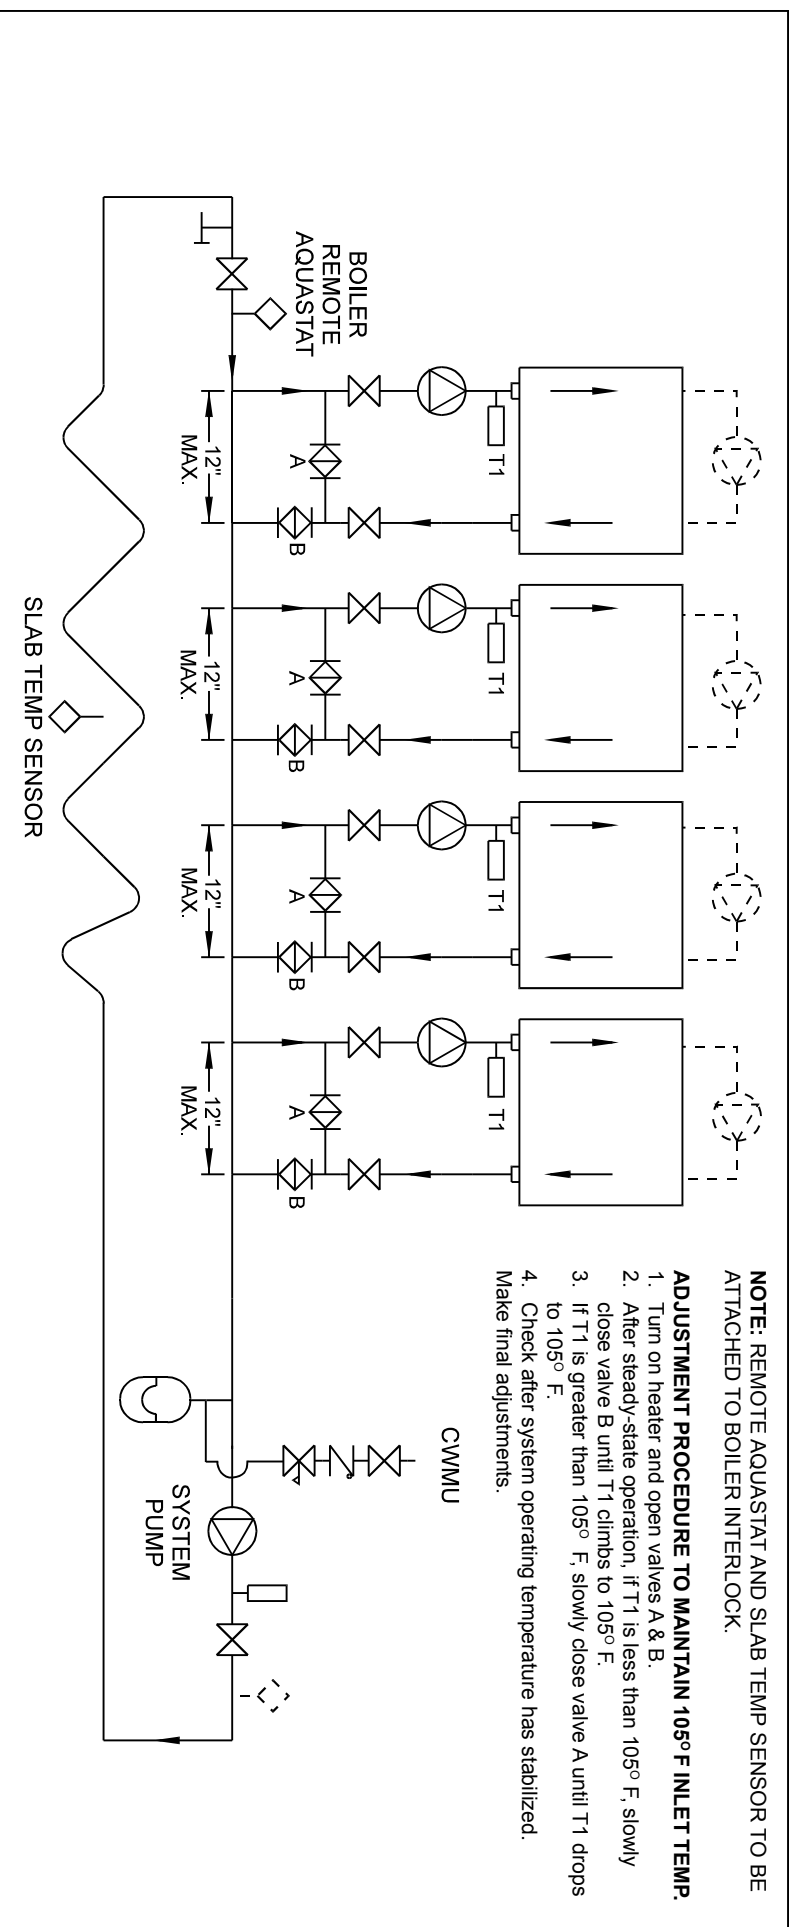

|      |       |                 |             |                         |             |                    |             |             |                                    |                   |
|------|-------|-----------------|-------------|-------------------------|-------------|--------------------|-------------|-------------|------------------------------------|-------------------|
| PUMP | VALVE | BALANCING VALVE | CHECK VALVE | PRESSURE REDUCING VALVE | 3-WAY VALVE | TEMPERATURE SENSOR | THERMOMETER | PURGE VALVE | EXP. TANK & AIR ELIMINATION DEVICE | UNIT MOUNTED PUMP |
|      |       |                 |             |                         |             |                    |             |             |                                    |                   |