


THIS DIAGRAM IS ONLY A SUGGESTED PLUMBING SCHEMATIC AND MAY NOT INCLUDE ALL STATE/LOCAL CODE REQUIRED EQUIPMENT, VALVE, ETC.

ALL EQUIPMENT AND PIPING SHALL BE SIZED BY CONSULTANT/ENGINEER.

INSTANTANEOUS WATER HEATER SYSTEM TO PREHEAT WATER PRIOR TO THE REVERSE OSMOSIS. BY PREHEATING THE WATER, THE R/O PROCESS IS MORE EFFICIENT. IF POST HEATING THE R/O OR DI SYSTEM, THE WATER HEATER WILL NEED TO BE TEFLON COATED.

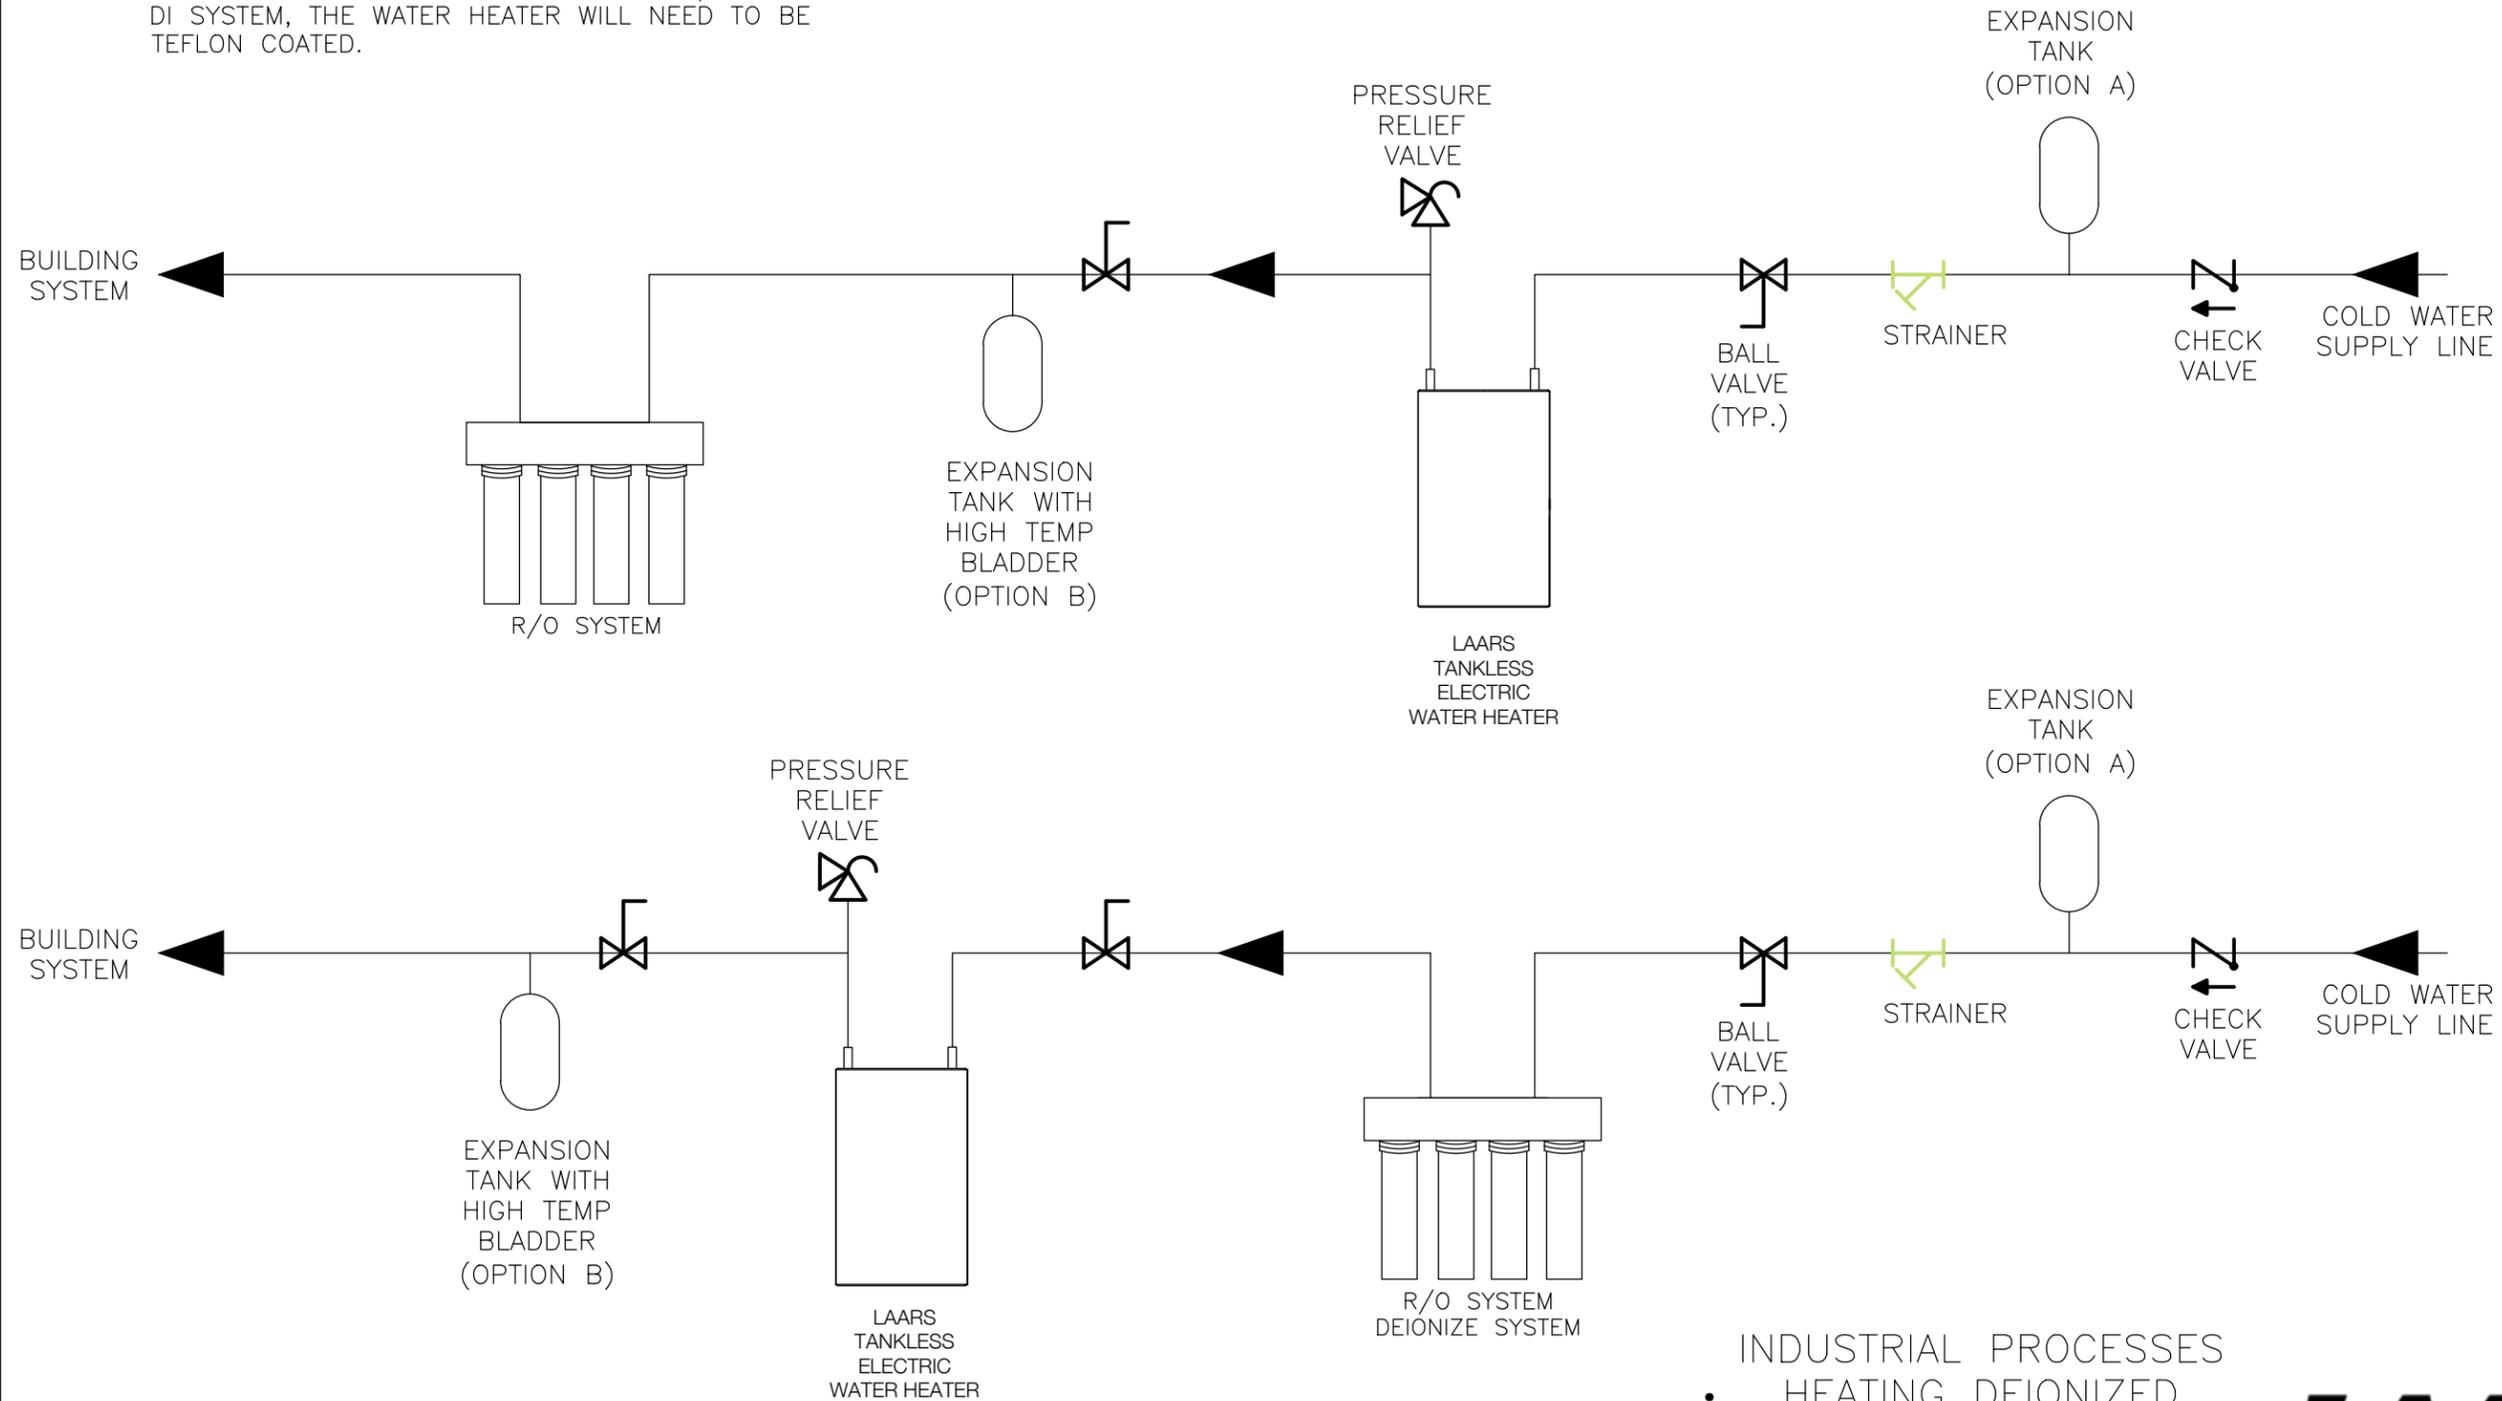

- INDUSTRIAL PROCESSES
- HEATING DEIONIZED
 - PRE-HEATING R/O WATER
 - HEATING R/O WATER W/TEFLON COATING

