


MIGHTY THERM²

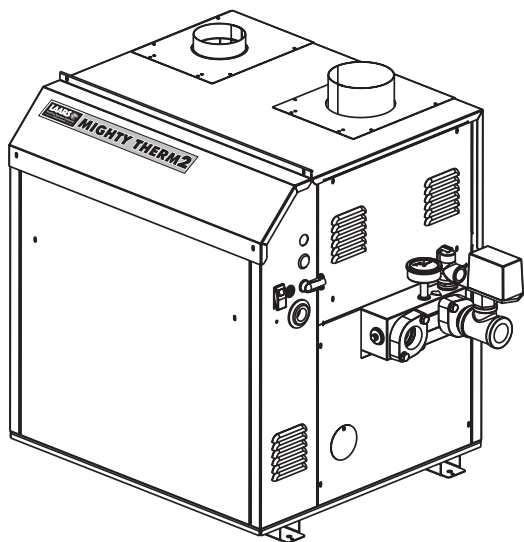

Boiler & Water Heater

MT2H | Hydronic Heater

MT2V | Volume Water Heater

Indoor/Outdoor Sizes 200-400

Submittal Data **LAARS**
Heating Systems Company

Date:

Project #:

Engineer:

Prepared By:

Bid Date:

Project Name:

Location:

Contractor:

Standard Equipment

- ASME 160 psi working pressure heat exchanger
- ASME "H" stamp
- Flanged water connections
- Glass-lined headers
- External header gaskets
- 75 psi (517 kPa) ASME rated pressure relief valve (MT2H)
- 125 psi (861 kPa) ASME rated pressure relief valve (MT2V)
- Low lead construction (MT2V)
- Temperature pressure gauge
- Multiple operating gas valve/pressure regulators
- Manual "A" gas valve
- Intake air filter
- Removable burner tray(s)
- Stainless steel burners
- Built-in fan for Category I or III vent systems
- Air pressure switch
- Blocked vent switch
- Burner site glass
- PI controller
- Outdoor reset with ratios of 0.4 to 3.6 (MT2H)
- Warm weather shutdown (MT2H)
- Indicator lights for power, heat call, DHW call and WWSD
- DHW operation
- Automatic boiler differential
- Pump pre-purge, post-purge and exercise
- Blower pre-purge and post-purge
- Inlet, outlet, outdoor and supply sensors
- Codes for sensor errors
- 24V control system
- 115/24V transformer
- Flow switch
- Manual reset high limit
- Fusible link (size 200)
- On-off firing
- Certified for indoor or outdoor use
- Hot surface ignition
- On/off toggle switch
- Pump time delay
- CSD-1 compliant
- Less than 10ppm NOx

Boiler Data

Model:

- ☐ Boiler MT2H
☐ Water Heater MT2V

Number of Units:

Fuel

- ☐ Natural
☐ Propane

Configuration

- ☐ On/Off (standard)
☐ Two-Stage (optional)

Heat Exchanger


- ☐ Copper
☐ Cupro-Nickel
☐ Copper, Reversed
☐ Cupro-Nickel, Reversed

Water Trim

- ☐ Glass-Lined Cast Iron
☐ Bronze Trim (std. on MT2V)

Options

- ☐ 200°F Max Controls (std. on MT2V)
☐ Low Water Cutoff
☐ ASME "HLW" Stamp (MT2V only)



Sizing Data

Model	Input		Output		A.F.U.E. %	Thermal Efficiency %	Gas Conn. Size NPT	Water Conn. Size NPT	Shipping Weight	
	BTU/h	kW	BTU/h	kW					lbs	kg
MT2H0200	200,000	58.6	170,000	50.4	85.1	N/A	3/4	1-1/2	270	123
MT2H0300	299,000	87.6	255,000	74.7	85.1	N/A	3/4	1-1/2	300	136
MT2H0400	399,000	116.9	340,000	99.6	N/A	85.3	3/4	1-1/2	330	150
MT2V0200	199,900	58.6	169,915	49.8	N/A	85.0	3/4	1-1/2	270	123
MT2V0300	300,000	87.9	255,000	74.7	N/A	85.0	3/4	1-1/2	300	136
MT2V0400	399,900	117.2	339,915	99.6	N/A	85.0	3/4	1-1/2	330	150

NOTES:

- Input and output must be derated 4% per 1000 feet above sea level when installed above 2000 feet altitude.
- Dimensions are nominal.
- For other boiler ratings:

$$\text{Boiler Horsepower: HP} = \frac{\text{Output}}{33,475} \quad \text{Radiation Surface: EDR sq. ft.} = \frac{\text{Output}}{150}$$

Accessories

- ☐ Side-wall vent terminal for indoor installation (required for side-wall venting)
- ☐ Side-wall combustion air terminal for indoor installation (required only for ducted combustion air)
- ☐ Outdoor vent terminal and combustion air terminal

Water Flow Data

MT2H (Boiler)

TEMPERATURE RISE

Size	20°F		11°C		25°F		14°C		30°F		17°C		35°F		19°C	
	Flow gpm	H/L feet	Flow lpm	H/L m	Flow gpm	H/L feet	Flow lpm	H/L m	Flow gpm	H/L feet	Flow lpm	H/L m	Flow gpm	H/L feet	Flow lpm	H/L m
200	17	1.6	64	0.5	14	1.0	53	0.3	11	0.7	42	0.2	10	0.5	38	0.2
300	26	3.5	97	1.1	20	2.3	76	0.7	17	1.6	64	0.5	15	1.2	57	0.4
400	34	6.3	129	1.9	27	4.0	102	1.2	23	2.8	87	0.9	19	2.1	72	0.6

MT2V (Water Heater)

Size	HARD WATER						NORMAL WATER						SOFT WATER					
	Flow gpm	H/L feet	Temp rise °F	Flow lpm	H/L m	Temp rise °C	Flow gpm	H/L feet	Temp rise °F	Flow lpm	H/L m	Temp rise °C	Flow gpm	H/L feet	Temp rise °F	Flow lpm	H/L m	Temp rise °C
200	45	7.3	8	170	2.2	4	35	4.4	10	133	1.3	6	23	1.9	15	87	0.6	8
300	45	7.4	11	170	2.3	6	35	4.5	15	133	1.4	8	23	2.0	22	87	0.6	12
400	45	7.4	15	170	2.3	8	35	4.5	19	133	1.4	11	23	2.0	30	87	0.6	17

Recovery Data

Size	WATER TEMPERATURE RISE IN °F								
	40°F GPH	50°F GPH	60°F GPH	70°F GPH	80°F GPH	90°F GPH	100°F GPH	120°F GPH	140°F GPH
200	510	408	340	291	255	227	204	170	146
300	765	612	510	437	383	340	306	255	219
400	1020	816	680	583	510	453	408	340	291

NOTE: GPH = gallons per hour.

Size	WATER TEMPERATURE RISE IN °C								
	22°C L/h	28°C L/h	33°C L/h	39°C L/h	44°C L/h	50°C L/h	56°C L/h	67°C L/h	78°C L/h
200	1928	1542	1285	1100	964	858	771	643	552
300	2892	2313	1928	1652	1448	1285	1157	964	828
400	3856	3084	2570	2204	1928	1712	1542	1285	1100

NOTE: L/h = Liters per hour.

Clearances

Appliance Surface	Required Clearance from Combustible Material		Suggested Service Access Clearance	
	inches	cm	inches	cm
Left Side	1	2.5	24	61.0
Right Side	1	2.5	24	61.0
Top	1	2.5	12	30.5
Back*	1	2.5	12	30.5
Front	1	2.5	36	91.4
Vertical Vent** (Category 1)	6	15.2		
Horizontal Vent (Category 3)	per UL1738 venting system supplier's instructions			


* When vent and/or combustion air connects to the back, recommended clearance is 36" 91cm.

** 1" when b-vent is used.


Electrical Data

MT2H & MT2V (non-pump mounted) Size	Boiler / Heater Circuit Size			Pump Delay Connection Rating			Blower
	Volts	Phase	Amps	Pilot Duty	Phase	Power	
200–400	120	Single	15	24V	Single	Up to 25VA	Included in Boiler Circuit


Dimensional Data

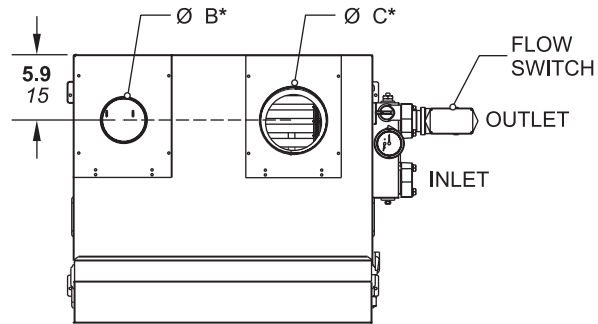


TOP VIEW

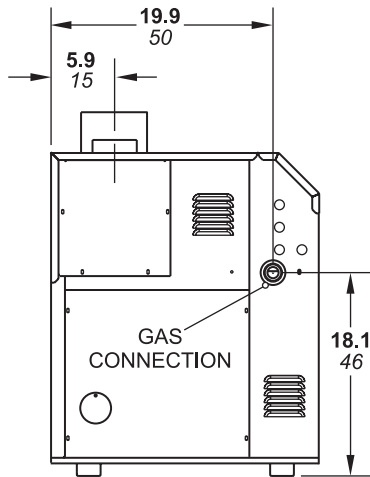


LEFT SIDE VIEW

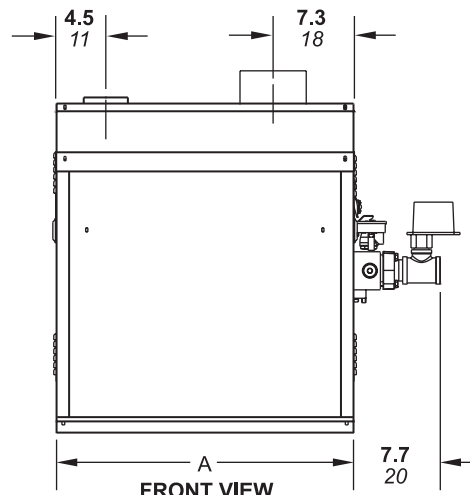

FRONT VIEW

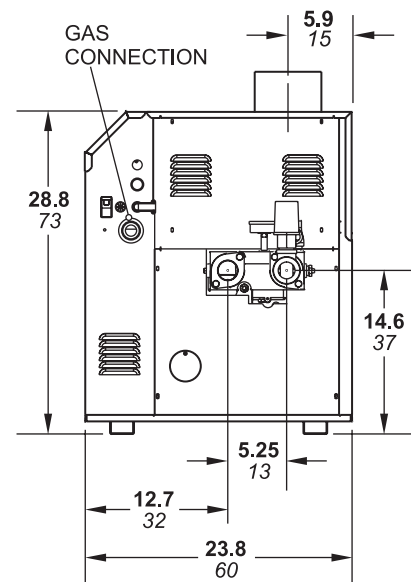

RIGHT SIDE VIEW

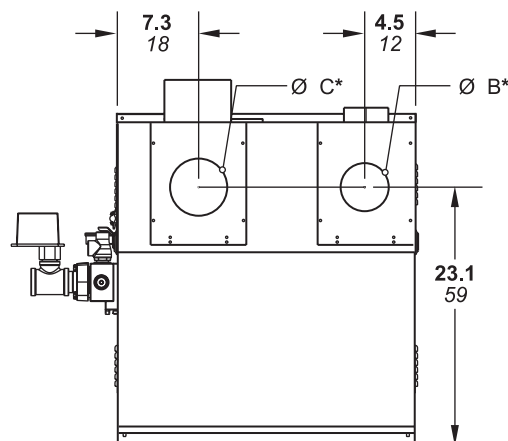

REAR VIEW

Size	A		Air Conn. B*		Vent Conn. C*		Horiz Vent Pipe	
	in	cm	in	cm	in	cm	in	cm
200	20½	52	4	10	5	13	4	10
300	26½	67	4	10	6	15	5	13
400	33½	85	6	15	7	18	6	15

*Air and vent connections may be on top or back of the Mighty Therm2, and are field convertible.

Laars Heating Systems Company reserves the right to change specifications, components, features, or to discontinue products without notice.