

Date:

Project #:

Engineer:

Project Name:

Prepared By:

Location:

Bid Date:

Contractor:

Standard Equipment

- High condensing efficiency
- Modulation down to 10% of full fire (10:1 turndown)
- Sealed combustion chamber
- Pre-mix stainless steel burner
- Low NOx system exceeds the most stringent regulations for air quality - 10 ppm NOx
- Horizontal or vertical direct vent
- Vent and air pipe lengths of up to 100 equivalent feet (each)
- Direct spark ignition system
- Electronic PID modulating control with large touchscreen and color display
- Controller cascades with up to four other NeoTherm LC boilers to lead/lag the boilers together
- Accepts external 4-20mA modulation control (0-10V with optional converter)
- Multiple pump control for boiler pump, system pump and indirect domestic water pump, each with delay
- Alarm output
- Indirect water heater priority
- Sensor for indirect domestic water tank
- Outdoor reset
- Outdoor air temperature sensor
- Manual reset high limit
- On/off toggle switch
- Vent temperature cutoff feature
- Built-in condensate trap
- 160 psi maximum working pressure
- Stainless steel heat exchanger with welded construction (no gaskets)
- ASME "H" stamp
- 75 psi (517 kPa) ASME rated pressure relief valve
- Water flow switch
- Temperature & pressure gauge
- Burner site glass
- 10-Year limited warranty

Boiler Data

Number of Units:

Fuel

- ☐ Natural
☐ Propane

Factory Mounted Options

- ☐ CSD-1 (covers FM & GAP)
☐ Low water cutoff
☐ High & Low gas pressure switches
☐ Pump Included
☐ Variable speed boiler pump control
- ☐ Additional auto reset high limit*
☐ Additional manual reset high limit*
☐ Bell for ignition failure
☐ Air filter
- ☐ 30 psi pressure relief valve
☐ 50 psi pressure relief valve
☐ 60 psi pressure relief valve
☐ 125 psi pressure relief valve
☐ 150 psi pressure relief valve

* Auto reset high limit and manual reset high limit cannot be ordered together.



Accessories for Field Mounting

- ☐ Low water cutoff
- ☐ High & low gas pressure switches
- ☐ Air filter
- ☐ Additional auto reset high limit*
- ☐ Additional manual reset high limit*
- ☐ VARI-PRIME, variable speed pump frequency drive
- ☐ Horizontal vent terminal for PVC / CPVC
- ☐ Horizontal vent terminal for stainless steel
- ☐ Horizontal air terminal for PVC / CPVC
- ☐ Horizontal air terminal for stainless steel or polypropylene
- ☐ Vertical air terminal for PVC / CPVC
- ☐ Screen kit for stainless steel or polypropylene vertical air or vent pipe
- ☐ Outdoor vent terminal
- ☐ Outdoor air terminal
- ☐ BACnet gateway
- ☐ LON gateway
- ☐ Condensate neutralizer kit
- ☐ Condensate neutralizer kit with pump
- ☐ 0-10V converter for modulation control
- ☐ Conversion kit, Nat to LP

Sizing Data

Model	Input		Output		Indoor Efficiencies		Outdoor Efficiencies		Gas Conn. size	Water Conn. size	Product Weight		Shipping Weight	
	BTU/h	kW	BTU/h	kW	Thermal	Combustion	Thermal	Combustion	inches	inches	lbs	kg	lbs	kg
<input type="checkbox"/> NTH 1000	999,000	293	942,000	276	94.2%	94.2%	94.2%	94.2%	1½	2	518	235	620	281
<input type="checkbox"/> NTH 1200	1,200,000	351	1,120,000	328	94.8%	95.1%	94.7%	95.1%	1½	2	538	244	640	290

NOTES:

For other boiler ratings:

Boiler Horsepower: HP = $\frac{\text{Output}}{33,475}$

Radiation Surface: EDR sq. ft. = $\frac{\text{Output}}{150}$

Clearances

Appliance Surface	Suggested Service Access Clearance		Clearance to Combustibles	
	inches	cm	inches	cm
Front	24	61	2	5.1
Left Side	12	30	0	0
Right Side	18	46	0	0
Top	24	61	8	20
Back	24	61	0	0
Vent	—	—	1	2.5

Electrical Data

Boiler Data				
Size	Volts	Phase	Amps FLA	Pump Connections Ratings
1000	120	Single	10	max 7.4 FLA
1200	120	Single	12	max 7.4 FLA

Pump Data			
Size	Volts	Phase	Amps
1000	115 / 230 V	Single	4.9 / 2.4 A
1200	115 / 230 V	Single	4.9 / 2.4 A

Vent System

Size	Intake (Air) Pipe	Exhaust (Vent) Pipe	Maximum Allowable Equivalent Length*	
1000	6"	6"	100 ft	30 m
1200	6"	6"	100 ft	30 m

Installations in the U.S. require exhaust vent pipe that is a combination of PVC and CPVC complying with ANSI/ASTM D1785 F441, polypropylene pipe that complies with ULC S636, or stainless steel complying with UL 1738. Installations in Canada require exhaust vent pipe that is certified to ULC S636.

NOTE: The first 12" (30cm) of vent must be CPVC if using a PCV vent system.

Intake (air) pipe may be ABS, PVC, CPVC or galvanized material.

Closet and alcove installations do not allow the use of PVC under any circumstances.


*To calculate max equivalent length, measure the linear feet of the pipe, and add 5 feet (1.5m) for each elbow used.

Water Flow Requirements


Temperature Rise in °F													
20°F			25°F		30°F		35°F		40°F		45°F		
	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	
Size	gpm	feet	gpm	feet	gpm	feet	gpm	feet	gpm	feet	gpm	feet	
1000	95	30	75	20	62	15	54	11	48	9	42	7	
1200	114	37	91	26	76	18	65	13	57	10	51	8	

Temperature Rise in °C												
11°C			14°C		17°C		19°C		22°C		25°C	
	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L	Flow	H/L
Size	lpm	m	lpm	m	lpm	m	lpm	m	lpm	m	lpm	m
1000	359	9.0	283	6.0	234	4.5	204	3.3	182	2.7	159	2.1
1200	432	11.3	344	7.9	288	5.5	246	4.0	216	3.0	193	2.4


Dimensional Data
NeoTherm LC
1000 & 1200

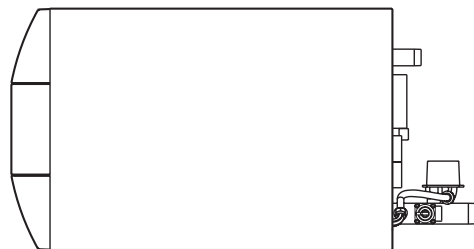


TOP

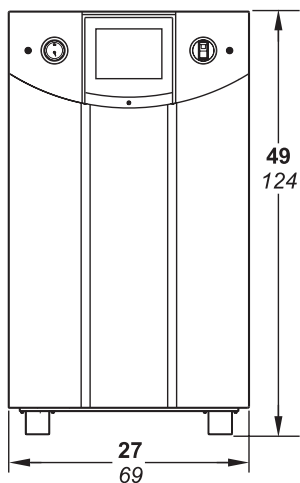

FRONT

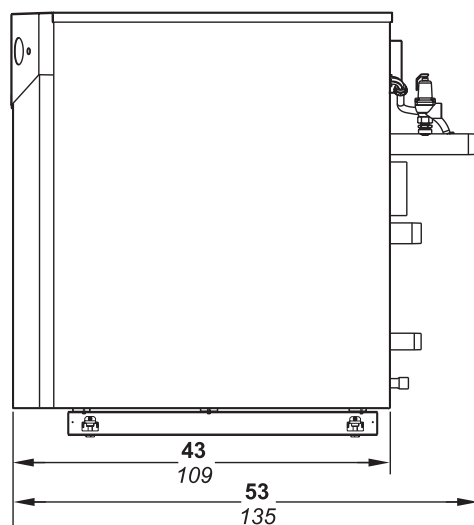

RIGHT

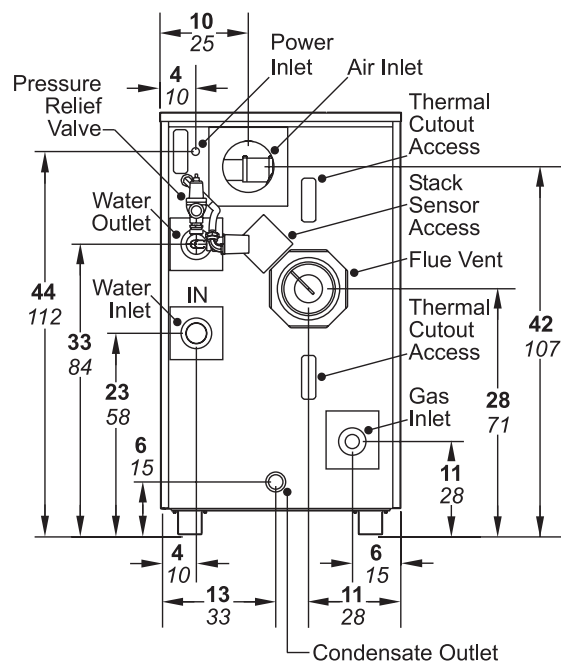

BACK

Laars Heating Systems Company reserves the right to change specifications, components, features, or to discontinue products without notice.